


REVISIONS			
REV.	DCN#	DESCRIPTION	DATE
X01	-	PRELIMINARY RELEASE	02/12/25


1. APPLICABLE STANDARDS AND SPECIFICATIONS;  
 ASME Y14.5-2009, DIMENSIONING AND TOLERANCING  
 ASME Y14.5-2007, ABBREVIATIONS

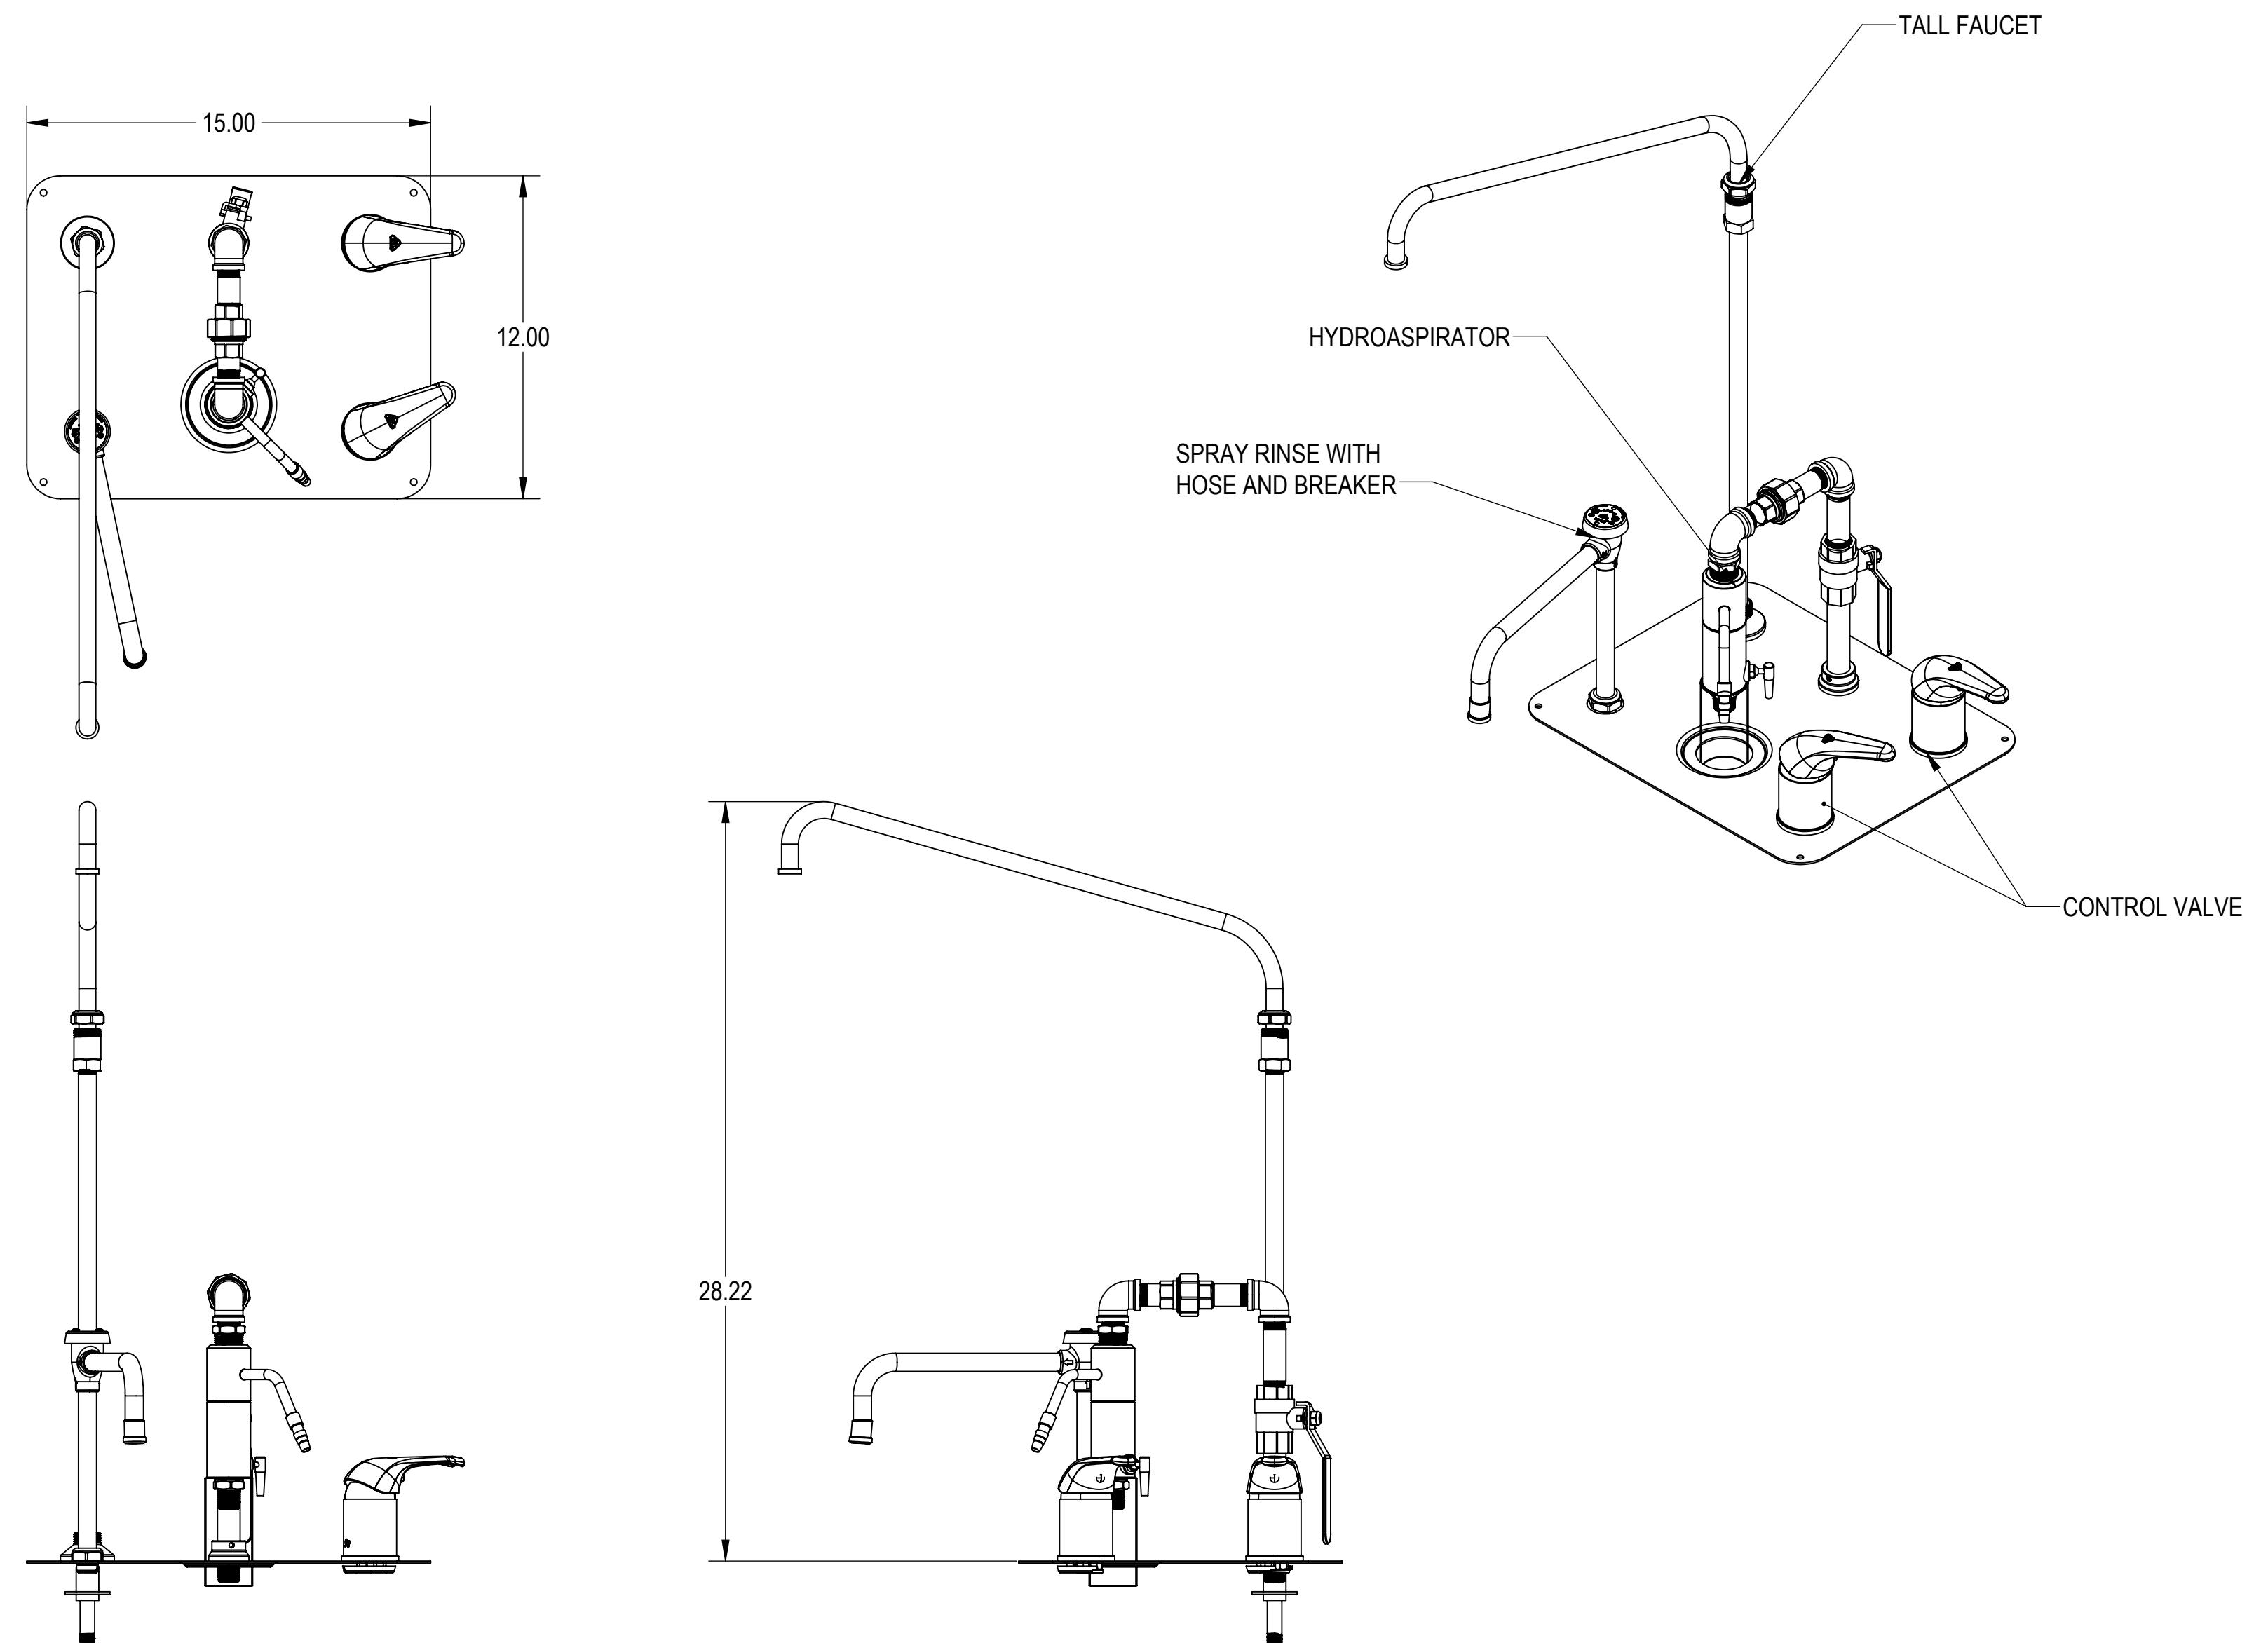

CUSTOMER  PROJECT	CUSTOMER NAME  LINE 1 LINE 2	APPROVAL	PROPRIETARY			TITLE	MOPEC GROUP Mopac Mortech ISO 9001:2015 CERTIFIED COMPANY	411 North Aerojet Avenue Azusa, CA 91702 tel: (800) 410-0100 (626) 334-1471 fax: (626) 334-1704 www.mortechmfg.com
			DO NOT SCALE DRAWING MATERIAL FINISH	APPROVALS DRAWN BY CHECKED BY APPROVED BY	DATE			
SIGNATURE	DATE	304 SS GRAINED				SCALE 1:5	NEXT ASSY.	REV. X01
			SHEET 1	OF 2				

## **NOTES: UNLESS OTHERWISE SPECIFIED**

1. A 12-7/8" X 9-7/8" minimum and a 13-1/8" X 10-1/8" maximum area for inlet plumbing to include the following: One (1) cold water supply, 3/4". One (1) hot water supply, 1/2" Supply sh off valves at each water supply.  
Provide 58-60 lbs. water pressure and 4 gallons per minute of flow for proper operation of hydro aspirator.
2. One (1) standard 1-1/2" waste line  
Plumber to provide shut off valve for water connection and P-Trap for drain.

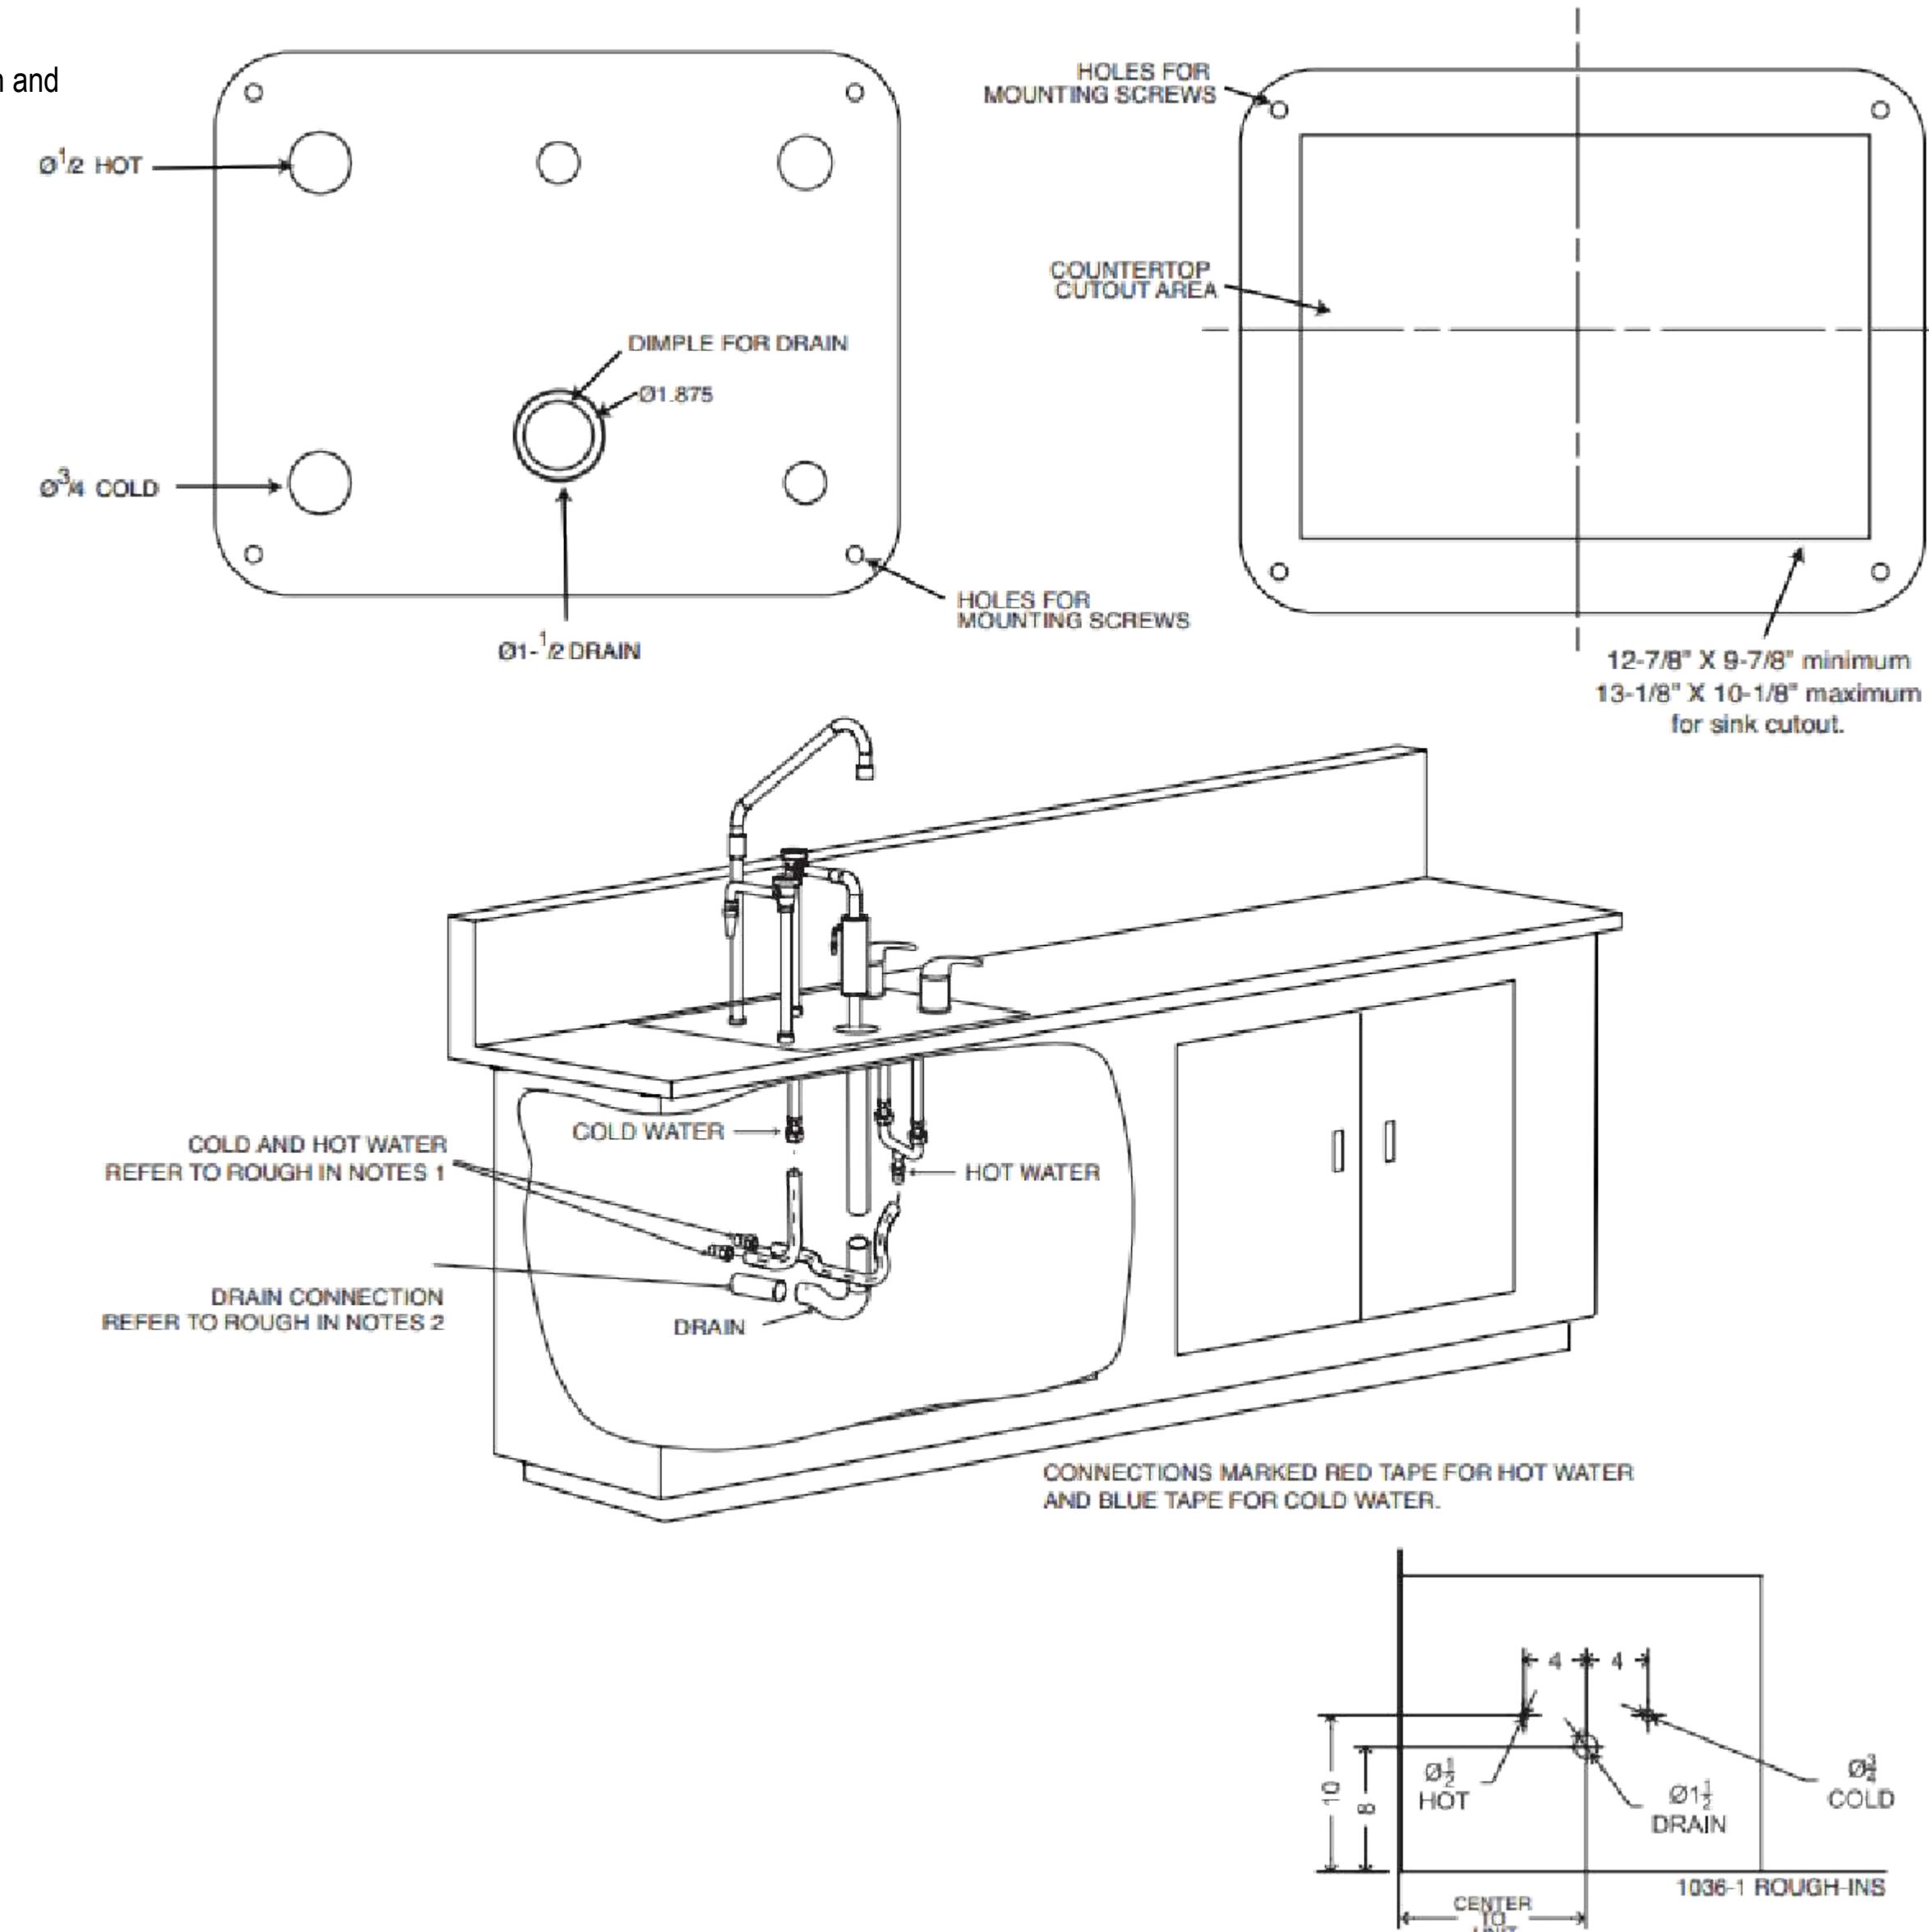

CUSTOMER <b>CUSTOMER NAME</b>	APPROVAL	<b>PROPRIETARY</b>			TITLE	<b>ISO 9001:2015 CERTIFIED COMPANY</b>	411 North Aerojet Avenue Azusa, CA 91702 tel: (800) 410-0100 (626) 334-1471 fax: (626) 334-1704 <a href="http://www.mortechmfg.com">www.mortechmfg.com</a>
		THIS DOCUMENT AND THE DATE DISCLOSED HEREIN AND HEREWITHE IS NOT TO BE REPRODUCED, USED, OR OTHERWISE DISCLOSED IN WHOLE OR IN PART TO ANYONE WITHOUT WRITTEN AUTHORIZATION FROM MORTECH MFG.					
PROJECT  <b>LINE 1</b>  <b>LINE 2</b>	DO NOT SCALE DRAWING		APPROVALS	DATE	SIZE <b>C</b>	DWG NO. <b>1036-1L-AP</b>	REV. <b>X01</b>
	SIGNATURE	DATE	MATERIAL  <b>304 SS</b>	DRAWN BY			
		FINISH  <b>GRAINED</b>	APPROVED BY	SCALE <b>1:5</b>	NEXT ASSY.	SHEET <b>2</b>	OF <b>2</b>